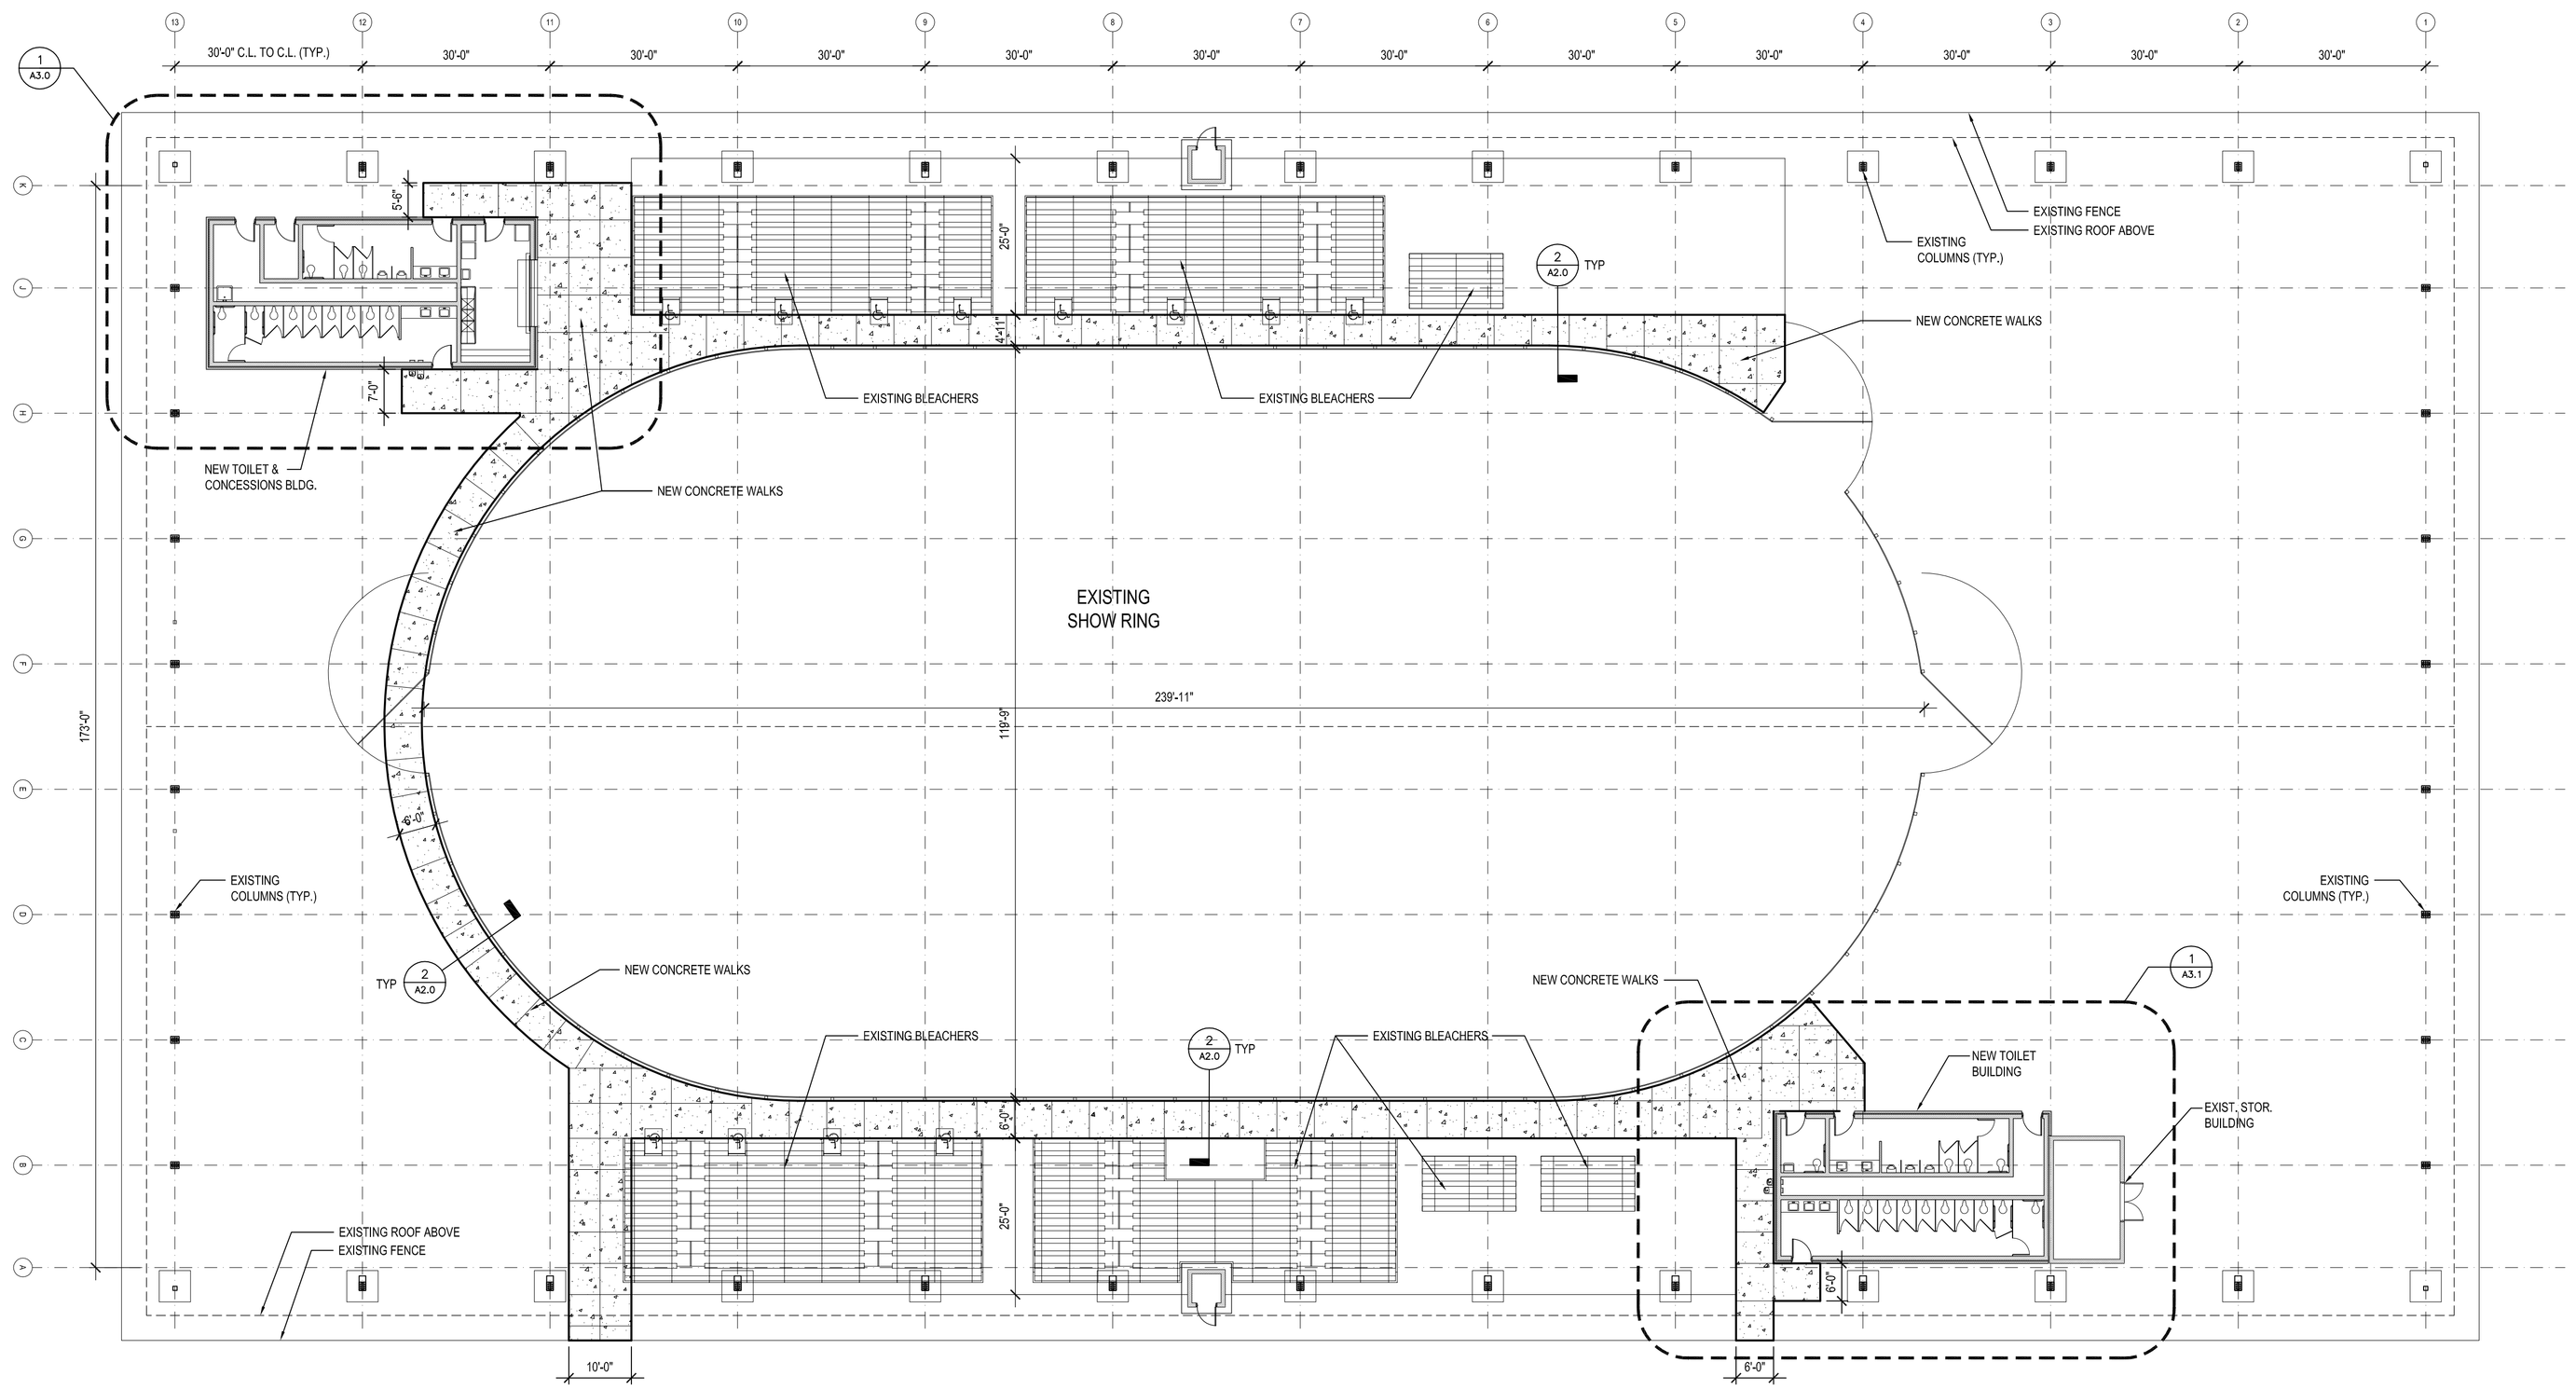

PROJECT NORTH

1 A2.0 ARENA FLOOR PLAN
1/16" = 1'-0"

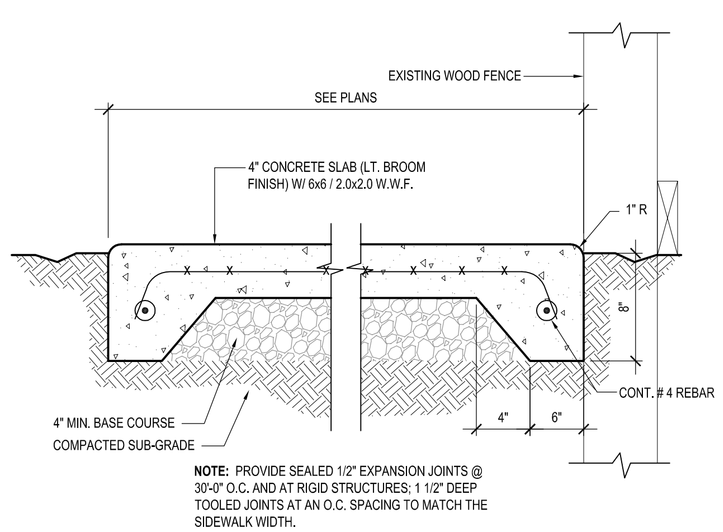

NOTE: PROVIDE SEALED 1/2" EXPANSION JOINTS @ 30'-0" O.C. AND AT RIGID STRUCTURES; 1 1/2" DEEP TOOLED JOINTS AT AN O.C. SPACING TO MATCH THE SIDEWALK WIDTH.

2 A2.0 SIDEWALK SECTION
1 1/2" = 1'-0"

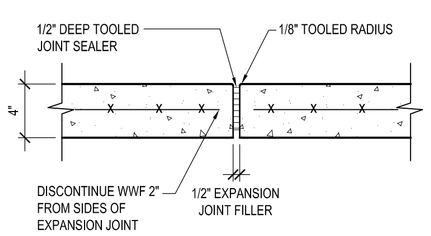

3 A2.0 TYP. EXPANSION JOINT
1 1/2" = 1'-0"

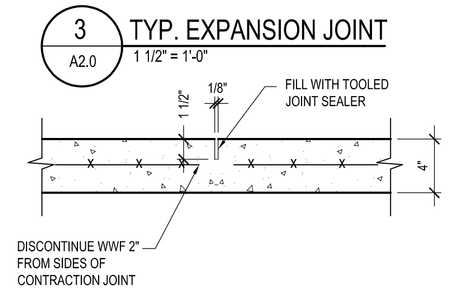

4 A2.0 TYP. CONTROL JOINT
1 1/2" = 1'-0"

NOTE:
DOOR SCHEDULE, ELEVATIONS, & DETAILS LOCATED ON A3-SERIES SHEETS.

GENERAL NOTES:

1. CONTRACTOR IS TO VERIFY ALL EXISTING CONDITIONS AND TOPOGRAPHIC ELEVATIONS PRIOR TO BEGINNING CONSTRUCTION. COORDINATE RAMP LENGTHS AND GUARD AND HANDRAIL LOCATIONS PER THE NOTATIONS ON SHEET A2.1.
2. NEW SPLIT FACE VENEER TO MATCH EXISTING STORAGE BUILDING SPLIT FACE COLOR.
3. CONTRACTOR IS TO SUBMIT SHOP DRAWINGS FOR ALL FINISHES, COLORS, MATERIAL CHOICES, CONTRACTOR-SUPPLIED EQUIPMENT, ETC.
4. ROLL UP DOOR AT CONCESSIONS STAND TO BE OWNER SUPPLIED AND CONTRACTOR INSTALLED. CONTRACTOR IS TO VERIFY REQUIREMENTS FOR THE DOOR AND ITS INSTALLATION PRIOR TO FRAMING ROUGH OPENING IN WALL. DIMENSIONS INDICATED ON THE DOOR SCHEDULE TO BE VERIFIED AND ADJUSTED AS REQUIRED. CONTRACTOR IS TO HOLD ON THE 2'-10" COUNTER HEIGHT AS INDICATED ON THE DRAWINGS.
5. SEE ELECTRICAL DRAWINGS FOR SWITCHES, OUTLETS, PANELS, ETC.
6. UNLESS NOTED OTHERWISE ON THE DRAWINGS, CMU LINTELS OVER DOORS TO CONSIST OF A CONCRETE-FILLED BOND BEAM WITH (2) #5 CONT. BARS TIED INTO VERTICAL JAMB REINFORCING ON EACH SIDE OF DOOR OPENING, ALSO FULLY GROUT FILLED.
7. LOCATE BUILDING SLAB CONTROL JOINTS AT 10'-0" O.C., MAX.
8. ALL SLABS TO REINFORCED WITH 6X6/10-10 W.W.F. CENTERED IN THE SLAB.
9. ALL CONCRETE TO HAVE A 28-DAY COMPRESSIVE STRENGTH OF 3,000 PSI.
10. ALL REINFORCING STEEL TO CONFORM TO ASTM-60 FOR DEFORMED BARS.
11. ALL WOOD STUDS, NAILERS OR BLOCKING IN CONTACT WITH CMU TO BE P.T. WOOD.
12. WOOD STUDS (WHERE REQ'D) TO BE FASTENED TO TOP OF SLAB WITH POWDER ACTUATED FASTENERS AT 32-INCHES O.C.
13. ALL HAND OR GUARD RAIL STEEL, PICKETS, PLATES, AND ASSOCIATED MATERIALS TO BE HOT DIPPED GALVANIZED AND PAINTED.
14. ALL RAMP SLAB TURNDOWN OR WALL EDGES TO HAVE A ¾-INCH CHAMFER.
15. ALL LANDING SLABS TO HAVE BETWEEN 1/8 AND 1/4 -INCH PER FOOT CROSS SLOPE FOR DRAINAGE.
16. ALL BEARING STRATA FOR FOOTINGS TO HAVE A CAPACITY OF 2,000 PSI. VERIFY IN FIELD.
17. ALL WOOD TRUSSES ARE TO BE ENGINEERED. SHOP DRAWINGS TO BE SUBMITTED TO ARCHITECT FOR REVIEW.
18. UNLESS NOTED OTHERWISE, ALL TRUSSES TO BE MECHANICALLY FASTENED TO WALLS WITH SIMPSON HURRICANE ANCHORS (OR EQUAL) ON EACH SIDE OF THE TRUSS.
19. CEILING GRID IS TO BE PRE-FINISHED (WHITE) AND THE ACOUSTICAL TILES ARE TO BE REGULAR SQUARE EDGE. SUBMIT TILE SHOP DRAWING TO ARCHITECT FOR APPROVAL.
20. DOOR HARDWARE AND LOCKSETS TO BE APPROVED BY ARCHITECT. MATCH EXISTING HARDWARE & LOCKSETS ON EXISTING STORAGE BUILDING. HARDWARE SHALL BE ADA COMPLIANT.
21. METAL ROOF PANELS TO BE 36" WIDE, 25 GA.

PADGETT & FREEMAN ARCHITECTS, P.A.
ARCHITECTURE • PLANNING • INTERIORS
30 Choctaw Street Asheville, NC 28801
P: 828 . 254 . 1963 F: 828 . 253 . 3307

REGISTERED ARCHITECTURAL CORPORATION NORTH CAROLINA
CERT. NO. 110
PADGETT & FREEMAN ARCHITECTS, PA.
ASHEVILLE, N.C.

REVIEW ONLY
NOT FOR CONSTRUCTION

NORTH CAROLINA REGISTERED ARCHITECT
SEAL 6182
JOHN F. GERALD
ASHEVILLE, N.C.

HAYWOOD COUNTY FAIRGROUNDS
TOILET FACILITIES & ACCESSIBILITY RAMP
CLYDE, NORTH CAROLINA

Revision

Project number
1062
Drawn by
CRC & JFS
Name
ARENA FLOOR PLAN & GENERAL NOTES

Date
OCTOBER 20, 2010
Sheet
A2.0